


# **Product Data**

### TRANE Link or ComfortLink™ II Variable Speed Heat Pumps

4TWV0X24A1000A 4TWV0X36A1000A 4TWV0X48A1000A 4TWV0X60A1000A



**Note:** "Graphics in this document are for representation only. Actual model may differ in appearance."

22-1953-1A-EN





### **Mechanical Specification Options**

#### General

This unit is designed to operate at outdoor ambient temperatures from  $55^{\circ}$  F to  $120^{\circ}$  F in cooling. From  $-10^{\circ}$  F to  $66^{\circ}$  F in heating (heat pumps only). Only AHRI approved indoor matches are approved for use with these models.

#### TRANE Link or ComfortLink™ II Heat Pumps

This outdoor unit contains the TRANE Link or ComfortLink™ II Heat Pumps digital communication with 2 wire connection to outdoor and Plug-n-Play set up.

#### Casing

Unit casing is constructed of heavy gauge. G60 galvanized steel and painted with a weatherresistant powder paint on all louvered panels and prepaint on all other panels. Corrosion and weatherproof CMBP-G30 DuraTuff<sup>™</sup> base.

WeatherGuard™II Top Shields Unit.

#### **Refrigerant Controls**

Refrigeration system controls include condenser fan, compressor contactor and high and low pressure switches. A factory supplied, field installed filter is standard.

#### Compressor

Inverter driven scroll compressor with 25 to 100% output capacity on heat pumps and 30 to 100% output capacity on air conditioners. Noise enclosure minimizes sound levels and built in compressor protection protects compressor will reduce operating speed and current draw to maintain operation while protecting the compressor.

#### Condenser Coil

The Spine Fin<sup>™</sup> outdoor coil provides low airflow resistance and efficient heat transfer. The coil is protected on all four sides by louvered panels.

SeaCoast Shield.

#### Low Ambient Cooling

As manufactured, this system has built in freeze protection that will allow cooling operation below 55°F but will reduce capacity or shut down completely to prevent operation under adverse conditions.

#### Comfort Control

The 1050/950/850 Control is required and provides Plug-n-Play setup and 3 wire connection.



### **Product Specifications**

#### **Heat Pump Models**

OUTDOOR UNIT (a) (b)	4TWV0X24A1000A	4TWV0X36A1000A	4TWV0X48A1000A	4TWV0X60A1000A
POWER CONNS. – V/PH/HZ <sup>(c)</sup>	208/230/1/60	208/230/1/60	208/230/1/60	208/230/1/60
MIN. BRCH. CIR. AMPACITY	17.0	26.0	29.0	37.0
BR. CIR. PROT. RTG. — MAX. (AMPS)	25	40	45	50
COMPRESSOR	SCROLL	SCROLL	SCROLL	SCROLL
NO. USED — NO. SPEEDS	1-VARIABLE	1-VARIABLE	1-VARIABLE	1-VARIABLE
R.L. AMPS <sup>(d)</sup> – L.R. AMPS	11.5 - 10.2	18.4 - 10.2	21.1 - 12.0	27.5 - 12.0
FACTORY INSTALLED				
START COMPONENTS (e)	NA	NA	NA	NA
INSULATION/SOUND BLANKET	YES	YES	YES	YES
COMPRESSOR HEAT	YES	YES	YES	YES
OUTDOOR FAN				
DIA. (IN.) — NO. USED	23 — 1	27.5 — 1	27.5 — 1	27.5 — 1
TYPE DRIVE - NO. SPEEDS	DIRECT - VARIABLE	DIRECT — VARIABLE	DIRECT — VARIABLE	DIRECT — VARIABLE
CFM @ 0.0 IN. W.G. <sup>(f)</sup>	2680	3670	4517	4757
NO. MOTORS — HP	1 - 1/3	1-1/3	1 - 1/3	1 - 1/3
MOTOR SPEED R.P.M.	200 — 1200	200 — 1200	200 — 1200	200 — 1200
VOLTS/PH/HZ	208/230/1/60	208/230/1/60	208/230/1/60	208/230/1/60
F.L. AMPS	2.8	2.8	2.8	2.8
OUTDOOR COIL – TYPE	SPINE FIN™	SPINE FIN™	SPINE FIN™	SPINE FIN™
ROWS — F.P.I.	1 — 24	1-24	1-24	1-24
FACE AREA (SQ. FT.)	19.77	27.87	27.87	30.80
TUBE SIZE (IN.)	3/8	3/8	3/8	3/8
REFRIGERANT	R410-A	R410-A	R410-A	R410-A
LBS. — R-410A (O.D. UNIT) <sup>(g)</sup>	7 lb — 6 oz	9 lb — 15 oz	11 lb — 5 oz	13 lb — 2 oz
FACTORY SUPPLIED	YES	YES	YES	YES
LINE SIZE — IN. O.D. GAS (h)	5/8	3/4	7/8	7/8
LINE SIZE — IN. O.D. LIQ. <sup>(h)</sup>	3/8	3/8	3/8	3/8
CHARGING SPECIFICATIONS				
SUBCOOLING	10°	9°	10°	10°
DIMENSIONS	HXWXD	HXWXD	HXWXD	HXWXD
CRATED (IN.)	49.9 X 30.1 X 33	51.6 X 35.1 X 38.7	51.6 X 35.1 X 38.7	55.6 X 35.1 X 38.7
WEIGHT				
SHIPPING (LBS.)	236	278	290	300
NET (LBS.)	215	252	264	274
-				1

(a) Certified in accordance with the Air-Source Unitary Air-conditioner Equipment certification program, which is based on AHRI standard 210/240.

(b) Rated in accordance with AHRI standard 270/275.

(c) Calculated in accordance with Natl. Elec. Codes. Use only HACR circuit breakers or fuses.

(d) This value shown for compressor RLA on the unit nameplate and on this specification sheet is used to compute minimum branch circuit ampacity and max. fuse size. The value shown is the branch circuit selection current.

(e) NA means no start components. Yes means quick start kit components. PTC means positive temperature coefficient starter.

(f) Standard Air — Dry Coil — Outdoor

(g) This value approximate. For more precise value see unit nameplate.

(h) Max. linear length 150 ft.; Max. lift — Suction 50 ft.; Max. lift — Liquid 50 ft.



## Sound Data

			A-Weighted			Ful	Octave	Sound Pov	wer [dB]		
Model	Mode	Speed	Sound Power Level [dB(A)]	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz
	Cool	Min	54	70.9	50.3	51.8	52.3	50.4	42.0	37.7	39.9
4TWV0X24A	Cool	Max	65	76.3	65.2	62.7	64.1	60.5	55.7	49.5	45.0
41WV0X24A	Heat	Min	60	69.8	52.9	52.8	57.5	55.2	51.9	47.4	46.5
	Heat	Max	69	75.9	66.0	64.7	67.3	65.6	57.0	52.2	47.7
	Cool	Min	59	69.3	56.0	54.8	54.5	56.8	46.6	38.0	39.0
4TWV0X36A	Cool	Max	70	79.7	70.2	68.5	66.3	65.8	63.2	56.9	51.4
41WV0X30A	Heat	Min	60	69.8	53.0	53.8	53.9	59.5	45.3	39.1	45.3
	Heat	Max	72	84.9	70.6	73.8	70.9	66.5	62.6	58.7	53.9
	Cool	Min	61	70.6	55.0	55.9	55.8	59.0	49.9	41.1	42.9
4TWV0X48A	Cool	Max	74	75.7	71.9	73.0	74.2	68.5	63.4	59.1	54.3
41WVUX46A	Heat	Min	62	72.1	59.3	58.7	60.3	58.6	51.3	46.0	45.2
	Heat	Max	76	77.9	74.5	77.0	75.4	69.5	64.4	60.8	56.2
	Cool	Min	57	69.7	59.5	57.6	55.1	52.0	45.0	41.6	42.3
4TWV0X60A	Cool	Max	73	83.9	73.7	73.1	71.2	67.9	64.4	58.9	51.8
41 W V UXOUA	Heat	Min	61	71.9	61.3	59.0	61.3	56.2	48.7	45.1	45.5
	Heat	Max	74	85.8	75.7	74.4	73.2	68.5	63.6	59.6	55.9

NOTE: Rated in accordance with AHRI Standard 270

Madal	Mada	Speed		Sound Pr	essure in dBA	
Model	Mode	Speed	at 3'	at 5′	at 10'	at 15'
	Cool	Min	47	42	36	33
47140101244	Cool	Max	58	53	47	44
4TWV0X24A	Heat	Min	53	48	42	39
	Heat	Max	62	57	51	48
	Cool	Min	52	47	41	38
4TWV0X36A	Cool	Max	63	58	52	49
41WVUX36A	Heat	Min	53	48	42	39
	Heat	Max	65	60	54	51
	Cool	Min	54	49	43	40
4TWV0X48A	Cool	Max	67	62	56	53
41WVUX40A	Heat	Min	55	50	44	41
	Heat	Max	69	64	58	55
	Cool	Min	50	45	39	36
4TWV0X60A	Cool	Max	66	61	55	52
41 W V UXOUA	Heat	Min	54	49	43	40
	Heat	Max	67	62	56	53

NOTE: Rated in accordance with AHRI Standard 275



### **Optional Accessories:**

Model	4TWV0X24A	4TWV0X36A	4TWV0X48A	4TWV0X60A
Rubber Isolator Kit	BAYISLT101	BAYISLT101	BAYISLT101	BAYISLT101
Snow Leg — Base & Cap 4″ High	BAYLEGS002	BAYLEG2002	BAYLEGS002	BAYLEGS002
Snow Leg — 4" Extension	BAYLEGS003	BAYLEGS003	BAYLEGS003	BAYLEGS003
Extreme Condition Mounting Kit	BAYECMT023	BAYECMT004	BAYECMT004	BAYECMT004
Refrigerant Lineset (a)				

(a) 25, 30, 35 and 50 foot linesets available. For a complete listing of lineset options available from equipment or supply stores, refer to the Trane Residential and Light Commercial Product Handbook.

### **General Data**

#### AHRI STANDARD 210/240 RATING CONDITIONS

- Cooling 80°F DB, 67°F WB air entering indoor coil, 95°F DB air entering outdoor coil.
- High Temperature Heating 47°F DB, 43°F WB air entering outdoor coil, 70°F DB entering indoor coil.
- Low Temperature Heating 17°F DB, 15°F WB air entering outdoor coil, 70°F DB air entering indoor coil.
- Rated indoor airflow for heating is the same as for cooling.

AHRI STANDARD 270 RATING CONDITIONS - (Noise rating numbers are determined with the unit in cooling operation) Standard Noise Rating number is at 95°F outdoor air.




### **Model Nomenclature**


<b>TTTTTTTTT</b>	Air Handler TAM8C0B36V31CA
Refrigerant Type	Brand T = Trane
2 = R-22	G = Good (Trane Branded)
4 = R-410A	Product Type A = Air Handler
	Convertability
ProductType	M= Multi-poise 4-way F = Upflow Front Return, 3-way T = 3-way
Product Family	Product Tier
/ = Variable Speed M or B = Basic Z = Leadership -Two Stage A = Light Commercial < = Leadership R = Replacement/Retail	2 = Good, Entry Level Feature Set 4 = Better, Retail Replacement Mid Effy 5 = Better, Entry Level High Effy, Multi-Speed 7 = Best, Retail Replacement High Effy
iamily SEER	8 = Best, Retail Ultimate High Effy Variable-Speed
i= 13 6 = 16 0 = 20 i= 14 8 = 18 i= 15 9 = 19	Major Design Change
Split System Connections 1-6 Tons	0 = Air Handler / Coil
) = Brazed Nominal Capacity in 000s of BTUs	Size (Footprint) A = 17.5 x 21.5
Major Design Modifications	B = 21.0 × 21.5 C = 23.5 × 21.5
lower Supply	Cooling Size: Air Handler or Coil 0-9 = AH Coil - 1000 BTU's (18, 24, 30, 36, 42, 48, 60)
= 200-230/1/60 or 208-230/1/60 = 200-230/3/60	Airflow Type & Capability
= 460/3/60	S = Low Effy PSC, 1-5 - nom. Tonnage (cfm/ton) M = Mid Effy Multi-Speed, 1-5 - nom. Tonnage (cfm/ton)
econdary Function	H = High Effy Multi-Speed, 1-5 - nom. Tonnage (cfm/ton) V = High EffyVariable, 1-5 - nom. Tonnage (cfm/ton)
linor Design Modifications	Power Supply
Init Parts Identifier	1 = 208-230/1/60
	System Control Type S = Standard - 24VAC
<b>1</b> 2 3 4 5 6 7 8 9 10 11 12 13 14 15	C = CLII 13.8 VDC
Gas Furnaces $\underline{T} \underline{U} + \underline{1} + \underline{0} = \underline{0} + \underline{0} + \underline{1} + \underline{0} = \underline{0} + \underline{0} + \underline{1} + \underline{1} + \underline{0} = \underline{0} + 0$	Minor Design Change
-urnace Configuration	
U = Upflow/Horizontal	Heat Pump/ 1 2 3 4 5 6 7 8 9 10 11 12 13 14 Cooling Coils 4 T X C B 0 36 A C 3 H C A
D = Downflow/Horizontal	
= 80% Induced Draft Standard	
D = 80% Induced Draft Premium C = 90% Condensing Standard	Refrigerant Type
X = 90% Condensing Premium I = 95% Condensing Premium	Series
	T = Premium (Heat Pump
	N - Premium (Convertible to HP)
= Single Stage	N = Premium (Convertible to HP) C = Standard
= Single Stage	C = Standard Coil Design ————————————————————————————————————
= Single Stage = Two Stage = Three Stage A = Modulating	C = Standard Coil Design — X = Direct Expansion Evaporator Coil
= Single Stage = Two Stage = Three Stage 1= Modulating abinet Width = 14.5° Cabinet Width	C = Standard Coil Design X = Direct Expansion Eveporator Coil Coil Feature C = Cased A Coil
= Single Stage = Two Stage = Three Stage 1= Modulating abinet Width = 14.5" Cabinet Width = 17.5" Cabinet Width	C = Standard Coil Design X = Direct Expansion Evaporator Coil Coil Feature
= Single Stage = Two Stage = Three Stage = Modulating abinet Width = 14.5" Cabinet Width = 17.5" Cabinet Width = 21.0" Cabinet Width	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage 1 = Modulating sabinet Width = 14.5° Cabinet Width = 21.0° Cabinet Width = 21.0° Cabinet Width = 24.5° Cabinet Width leating Input in 1000's (BTUH)	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage 1 = Modulating abinet Width = 14.5° Cabinet Width = 21.0° Cabinet Width = 21.5° Cabinet Width = 24.5° Cabinet Width leating Input in 1000's (BTUH) 80 = 80,000 BTUH	C = Standard Coil Design X = Direct Expansion Evaporator Coil Coil Feature C = Cased A Coil A = Uncased A Coil F = Cased Horizontal Flat Coil Coil Width (Cased/Uncased) A = 14.5" / 13.3" B = 17.5" / 16.3" C = 21.0" / 19.8"
= Single Stage = Two Stage = Three Stage A = Modulating Sabinet Width = 14.5" Cabinet Width = 21.0" Cabinet Width > = 24.5" Cabinet Width > = 24.5" Cabinet Width leating Input in 1000's (BTUH) 80 = 80,000 BTUH Major Design Change	C = Standard Coil Design X = Direct Expansion Evaporator Coil Coil Feature C = Cased A Coil A = Uncased A Coil F = Cased Horizontal Flat Coil Coil Width (Cased/Uncased) A = 14.5" / 13.3" B = 17.5" / 16.3"
= Single Stage = Two Stage = Three Stage = A.S" Cabinet Width = 14.5" Cabinet Width = 17.5" Cabinet Width = 21.0" Cabinet Width = 21.0" Cabinet Width = 21.5" Cabinet Width leating Input in 1000's (BTUH) 80 = 80,000 BTUH Major Design Change oltage = 115 Volts / 60 Hertz / Natural Gas	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating abinet Width = 14.5° Cabinet Width = 21.5° Cabinet Width = 24.5° Cabinet Width Beating Input in 1000's (BTUH) Bo = 80,000 BTUH Major Design Change = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / 50 Hertz / Natural Gas	C = Standard Coil Design X = Direct Expansion Evaporator Coil Coil Feature C = Cased A Coil A = Uncased A Coil F = Cased Horizontal Flat Coil Coil Width (Cased/Uncased) A = 14.5" / 13.3" B = 17.5" / 16.3" C = 21.0" / 19.8" D = 24.5" / 23.3" H = 10.5" Refrigerant Line Coupling 0 = Brazed
= Single Stage = Two Stage = Two Stage = There Stage 1 = Modulating abinet Width = 14.5° Cabinet Width = 21.0° Cabinet Width = 24.5° Cabinet Width eating Input in 1000's (BTUH) 80 = 80,000 BTUH tajor Design Change = 115 Volts / 60 Hentz / Natural Gas = 115 Volts / 50 Hentz / Natural Gas = 115 Volts / S0 Hentz / Natural Gas = 115 Volts / Natural Gas with Incommunicating System Control = 115 Volts / Natural Gas with Incommunicating System Control	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating abinet Width = 14.5° Cabinet Width = 21.5° Cabinet Width = 224.5° Cabinet Width leating Input in 1000's (BTUH) = 24.5° Cabinet Width leating Input in 1000's (BTUH) = 80 = 80,000 BTUH Major Design Change = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / 50 Hertz / Natural Gas = 115 Volts / Natural Gas with Incommunicating System Control = 115 Volts / Natural Gas with Incommunicating System Control	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating Subinet Width = 17.5° CabinetWidth = 21.0° CabinetWidth = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / 50 Hertz / Natural Gas = 115 Volts / 50 Hertz / Natural Gas = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Integrated Electronic Filter = 115 Volts / Natural Gas with Integrated Electronic Filter = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Integrated Electronic Filter = 115 Volts / Natural Gas with Integrated Electronic Filter = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Metager Mathematicating System Control	C = Standard Coil Design
Air Capacity for Cooling           Standard PSC         Variable Speed           High Efficiency           14 = 2 Tons         V3 = 3 Tons           6 = 3 Tons         V4 = 4 Tons	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating Abinet Width = 21.0° CabinetWidth = 21.0° CabinetWidth = 21.0° CabinetWidth = 21.0° CabinetWidth = 21.0° CabinetWidth = 21.0° CabinetWidth Heating Input in 1000's (BTUH) Major Design Change = 115 Volts / 60 Hetz / Natural Gas = 115 Volts / 60 Hetz / Natural Gas = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control and Integrated Electronic Filter With Capacity for Cooling Gandard PSC Variable Speed High Efficiency 4 = 2 Tons V3 = 3 Tons H3 = 3 Tons 6 = 3 Tons V4 = 4 Tons H4 = 4 Tons 2 = 3.5 Tons V5 = 5 Tons	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating Zabinet Width = 21.0° CabinetWidth = 21.0° Cabin	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating abinet Width = 21.0° CabinetWidth = 21.0° CabinetWidth = 21.0° CabinetWidth = 22.0° CabinetWidth = 24.5° CabinetWidth = 24.5° CabinetWidth = 24.5° CabinetWidth = 24.5° CabinetWidth = 24.5° CabinetWidth = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / 80 Hertz / Natural Gas = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control and Integrated Electronic Filter Nir Capacity for Cooling Standard PSC Variable Speed High Efficiency 44 = 2 Tons V4 = 4 Tons H3 = 3 Tons 45 = 3 Tons V4 = 4 Tons 45 = 4 Tons 48 = 4 Tons 48 = 4 Tons 48 = 4 Tons 49 = 5 Tons	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating abinet Width = 21.0° Cabinet Width = 21.0° Cabinet Width = 21.0° Cabinet Width = 24.5° Cabinet Width = 21.5° Cabinet Width = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control and Integrated Electronic Filter ir Capacity for Cooling = 15 Volts / Natural Gas With Communicating System Sons 6 = 3 Tons V4 = 4 Tons H3 = 3 Tons 5 = 4 Tons 8 = 4 Tons 4 = 5 Tons 2 = 6 Tons 2 = 6 Tons	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating abinet Width = 14.5° Cabinet Width = 21.5° Cabinet W	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage = Three Stage = Three Stage = Modulating abinet Width = 14.5° Cabinet Width = 21.0° Cabinet Width = 21.0° Cabinet Width = 24.5° Cabinet Width = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas = 3 Tons V3 = 3 Tons H3 = 3 Tons 6 = 3 Tons V4 = 4 Tons H4 = 4 Tons 2 = 3.5 Tons V5 = 5 Tons H5 = 5 Tons 5 = 4 Tons 8 = 4 Tons 8 = 4 Tons 4 = 5 Tons 2 = 6 Tons Draft Inducer Speeds = Single Speed = Two Speed	C = Standard Coil Design
= Single Stage = Two Stage = Three Stage A = Modulating abinet Width = 21.6" Cabinet Width = 21.0" Cabinet Width = 21.0" Cabinet Width = 24.8" Cabinet Width = 115 Volts / 60 Hertz / Natural Gas = 115 Volts / 50 Hertz / Natural Gas = 115 Volts / 50 Hertz / Natural Gas = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas with Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / Natural Gas With Communicating System Control = 115 Volts / So Herz / Natural Gas = 15 Not System System Control = 115 Volts / So Herz / Natural Gas = 15 Not System System System Control = 115 Volts / So Herz / S	C = Standard Coil Design



### Wiring

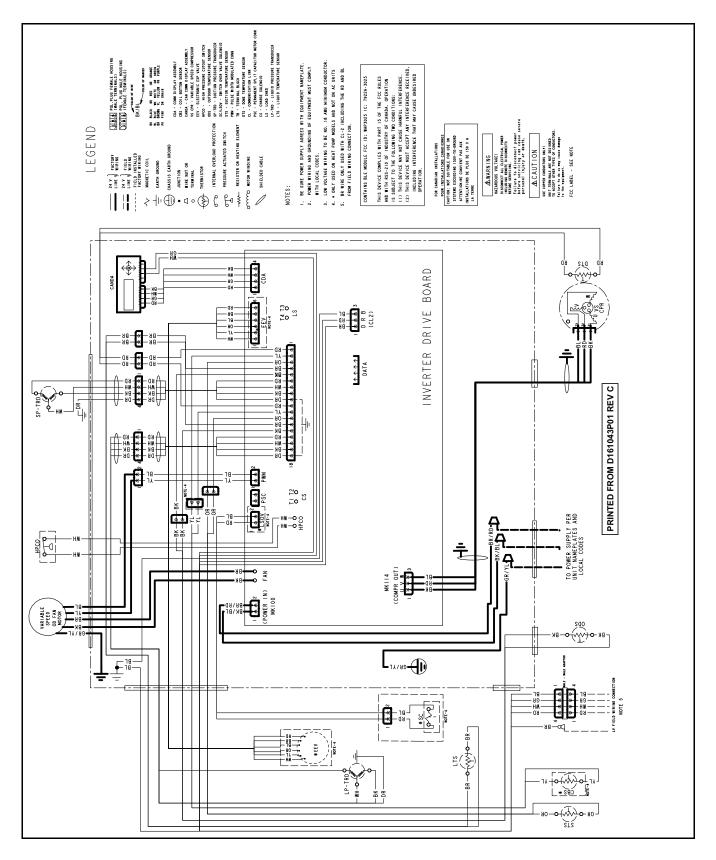





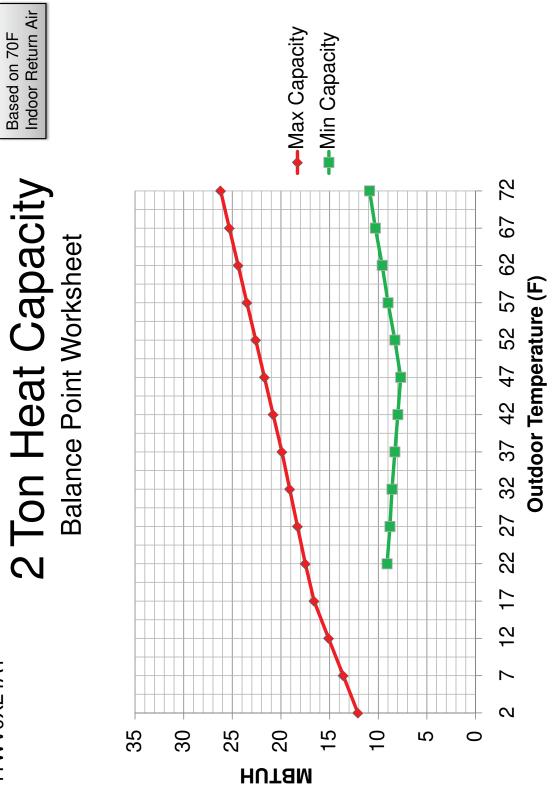


22-1953-1A-EN

4TWV0X24A1

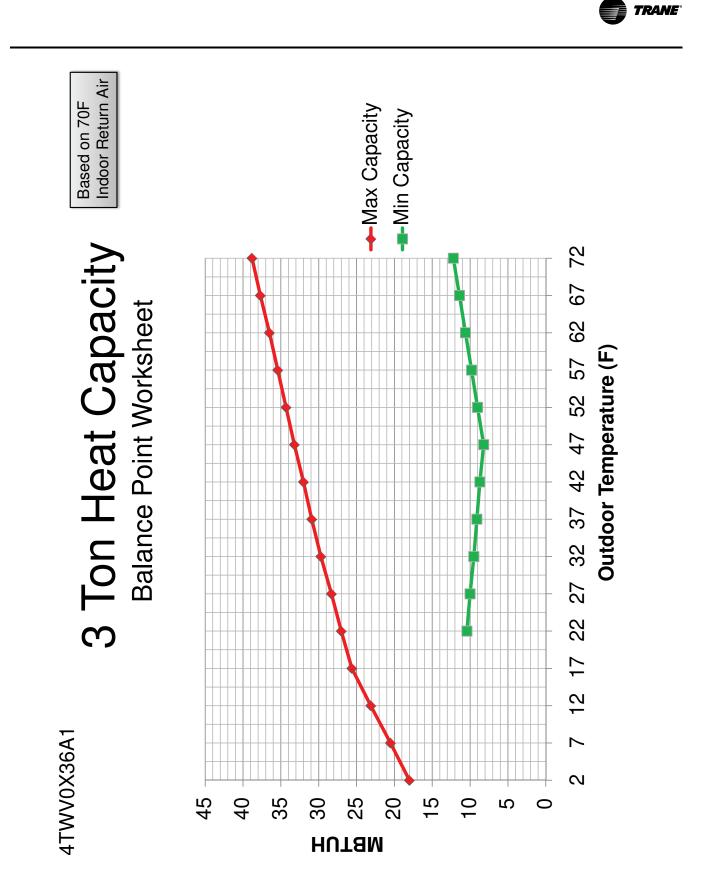

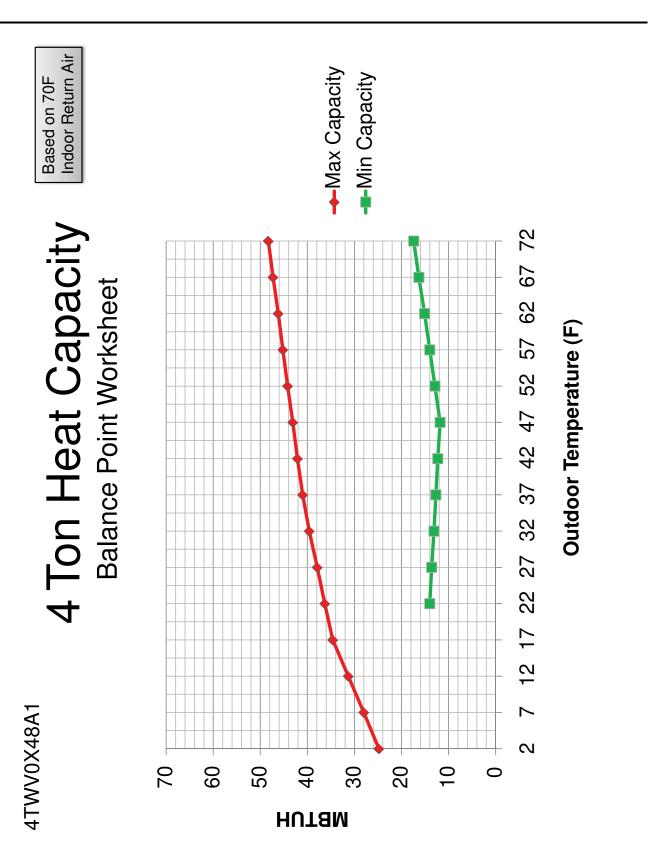

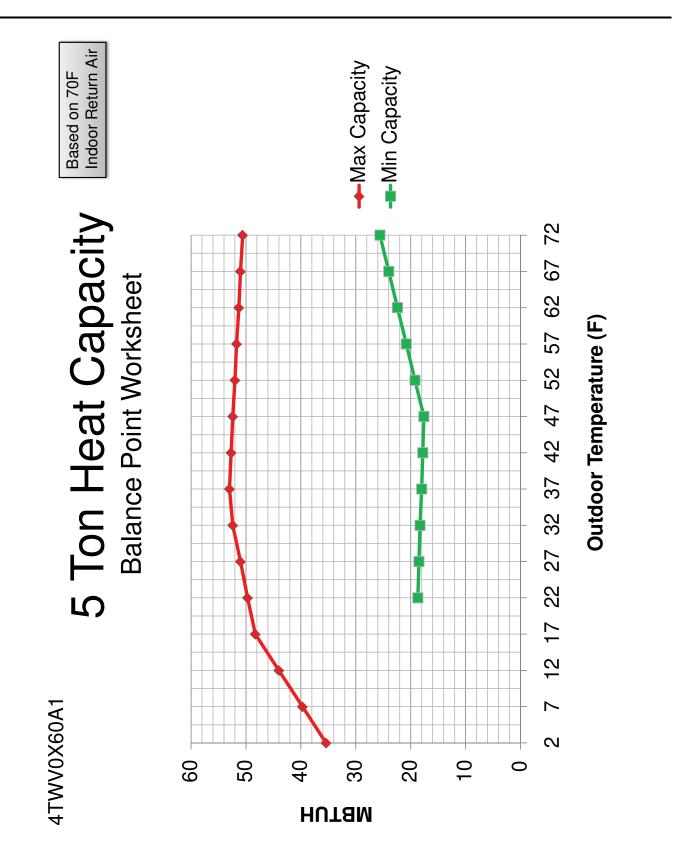





Trane - by Trane Technologies (NYSE: TT), a global innovator - creates comfortable, energy efficient indoor environments for commercial and residential applications. For more information, please visit trane. com or tranetechnologies.com.



The AHRI Certified mark indicates Trane U.S. Inc. participation in the AHRI Certification program. For verification of individual certified products, go to ahridirectory. org.

Trane has a policy of continuous data improvement and it reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.